
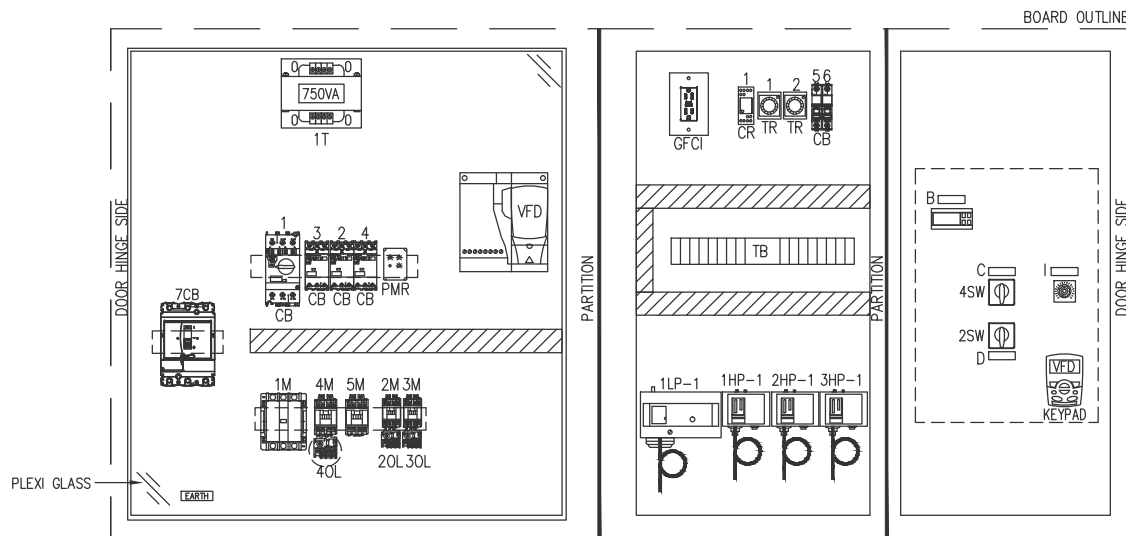




\*NOTES :

1. CONTROL PANEL OUTSIDE DOORS SHALL BE 12 GAUGE.
2. CONTROL PANEL DRAIN HOLE AT 2 CORNERS.

TAGS:-

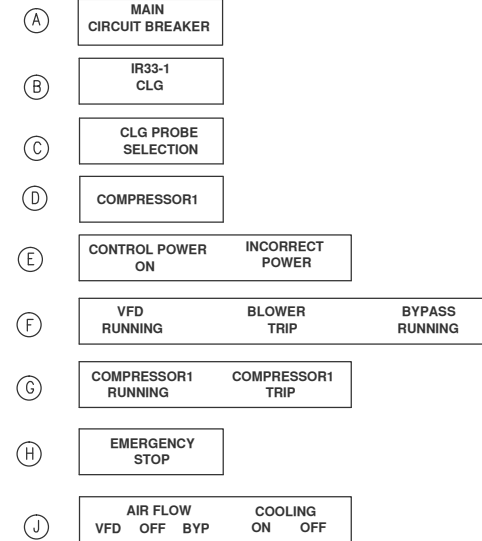

02. 01. REV.	ADD 20L & 30L REFER PAGE 2 & 4 OF 4	27.11.17 02.11.17	JUN JUN	HANIS	LOW KC	THIS DOCUMENT IS THE PROPERTY OF SMARTECH AND SHOULD NOT BE DISCLOSED OR USED WITHOUT THE EXPRESSED CONSENT OF COMPANY		PROJECT: 40 Ton rental AC unit		TITLE: SCHEMATIC WIRING DIAGRAM	
						DRAWN BY: JUN	DATE: 12.10.2017	MODEL: SACP 40A-HS		DRAWING NO: S210840218	
						CHECKED BY: HANIS	DATE: 17.10.2017	UNIT NO:		F.O NO:	
						APPROVED BY: LOW KC	DATE: 20.10.2017			SHEET 3	