



- *NOTES :
- 1. CONTROL PANEL OUTSIDE DOORS SHALL BE 12 GAUGE.
 - 2. CONTROL PANEL DRAIN HOLE AT 2 CORNERS.

TAGS: -

- (A) MAIN CIRCUIT BREAKER
 - (B) IR33-1 CLG
 - (C) CLG PROBE SELECTION
 - (D) COMPRESSOR1 COMPRESSOR2
 - (E) CONTROL POWER ON INCORRECT POWER
 - (F) VFD RUNNING BLOWER TRIP BYPASS RUNNING
 - (G) COMPRESSOR1 RUNNING COMPRESSOR1 TRIP COMPRESSOR2 RUNNING COMPRESSOR2 TRIP
 - (H) EMERGENCY STOP
 - (J) AIR FLOW VFD OFF BYP COOLING ON OFF
- (I) SPD ADJ POT MIN MAX

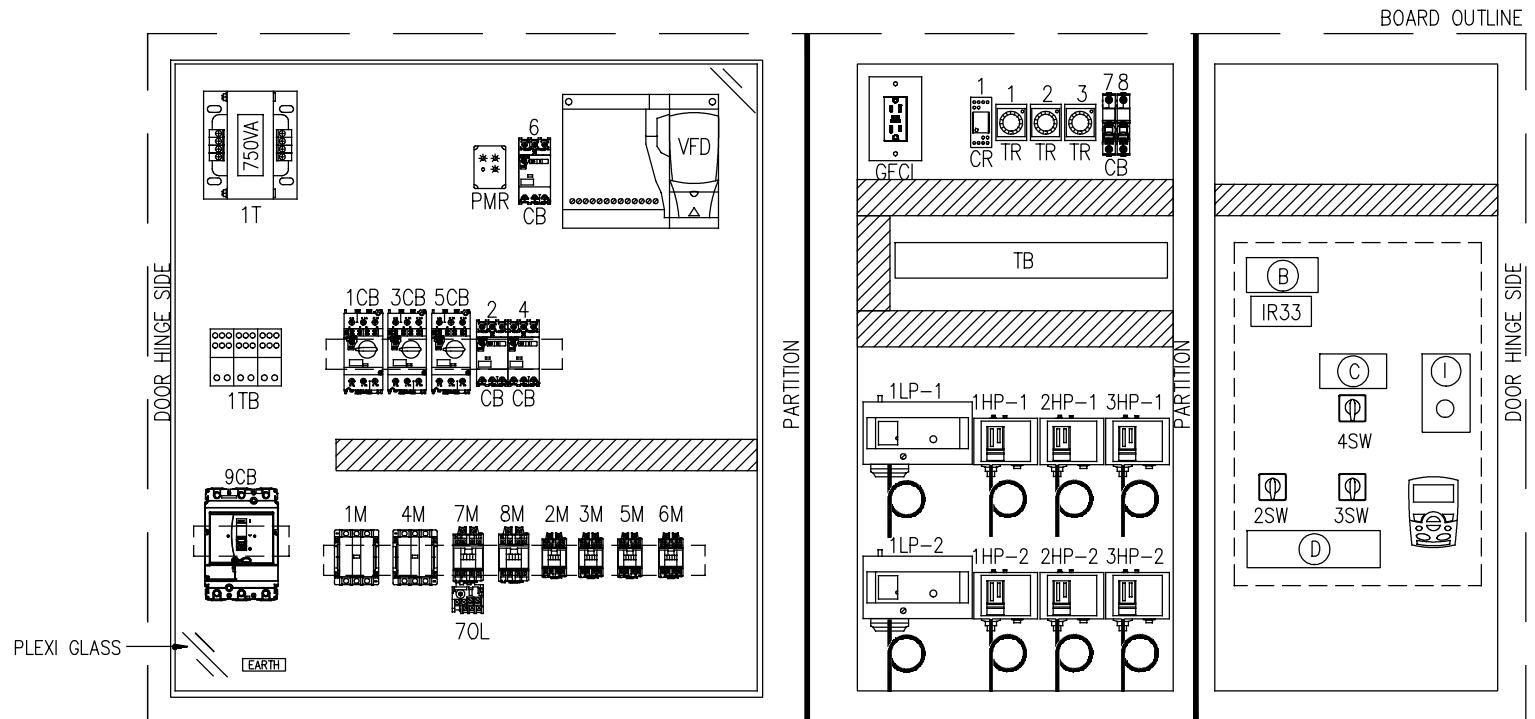

02. 01. REV.	UPDATE LAYOUT REFER PAGE 2 OF 4 DESCRIPTION	04.05.17 21.03.17 DATE	JUN JUN REV. BY	JUN JUN CHK'D. BY	LOW KC APP'D BY	THIS DOCUMENT IS THE PROPERTY OF SMARTECH AND SHOULD NOT BE DISCLOSED OR USED WITHOUT THE EXPRESSED CONSENT OF COMPANY		PROJECT: 80 Ton rental AC unit		 SMART FAMILY OF COOLING PRODUCTS <small>www.SmartCooling Products.com 281-540-2805</small>					
						DRAWN BY: JUN		DATE: 02.03.2017		MODEL: SACP 80A-HS		TITLE: SCHEMATIC WIRING DIAGRAM			
						CHECKED BY:		DATE:		UNIT NO:		DRAWING NO: S210840201		F.O NO:	
						APPROVED BY: LOW KC		DATE: 02.03.2017				SHEET 3			